

6





5

4

3

2

1

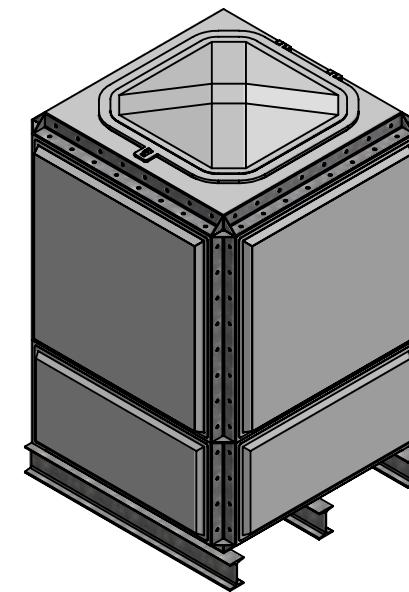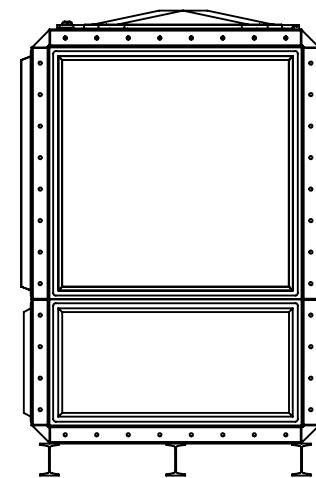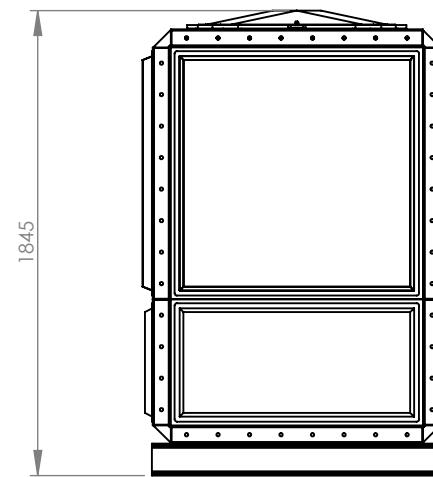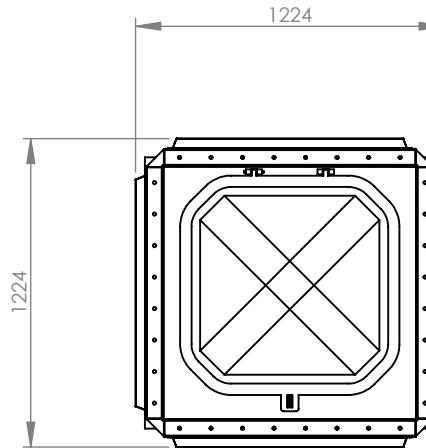

A

TITLE  
PW.1x1x1.5.TIF.AG

## NOTE:

Purewater sectional tanks must be fully supported on a flat, level & continuous foundation which provides structural support to the tank when full to maximum capacity. It is essential that the installer and/or user refers to the conditions of the installation document prior to the installation of the tank. Under no circumstances should any part of the tank structure be used to provide support to pipework and/or any ancillary items.

DRAWN BY N.Amechi DATE 30/01/2023

CUSTOMER

CUSTOMER  
ALL DIMENSIONS +/- 5mm  
UNLESS OTHERWISE STATED

A4

ALL DIMENSIONS IN MM - DO NOT SCALE

DATE	VERSION	NOTES
24/01/2023	A	FIRST ISSUE

## TANK SPECIFICATION :

INTERNAL DIMENSIONS	1150 x 1150 x 1150mm
EXTERNAL DIMENSIONS	1224 x 1124 x 1845mm
NOM. CAPACITY	2182 Litres
INSULATION THICKNESS	38mm
MATERIAL	Hot press moulded GRP

purewater  
storage ltd

SCALE:1:30 SHEET 1 OF 1

6

5

4

3

2

1

D

C

B

A