

# **Uninterruptible Power Supply**

## **User Manual**

**Line Interactive UPS**

**500va—1500va**

## 1. Remarks about Safety

(In order to keep safe in using the UPS, please comply with the following:)

■ Please charge the battery at least 12 hours before the UPS is in operation.

■ After the battery is discharged or over three months without operation, the battery should be charged immediately for at least 12 hours, ensuring the battery is full and avoiding any unnecessary damage of the battery.

■ The UPS is specially designed for computer only and it should not be connected with any inductive or capacitive load, like electromotor, daylight lamp, laser printer, etc.

■ The UPS is not suitable for being used in life support systems, because it may have some problems and bring trouble to the life support systems. The responsibility will be users', if they insist on using the UPS in life support systems.

■ It is normal that the temperature of the UPS surface reaches up to 50°C when it is in operation.

■ When AC fails and the “ON” button on the front panel is pressed, the UPS will output voltage; if the “OFF” button on the front panel is pressed, the UPS will not output voltage.

■ It is forbidden to open the case, because there is danger with electricity. If there is problem, please handle with the instruction of experts.

■ It is forbidden to put container containing liquid inside on the UPS, because it will cause danger of electric shock or fire when the UPS short-circuits.

■ When the UPS is abnormal, please cut off power immediately and turn to experts or the dealer for help.

■ As there is no overload protection of the UPS, it can not be overloaded. Otherwise, it would cause danger.

■ It is strictly forbidden to place and operate the UPS in the following environment :

lPlace with inflammable gas or corrosive gas or much dust;

lPlace with very high temperature or very low temperature(above 42°C or below 0°C) or high humidity(above 90%) ;

lPlace with direct sunlight or near heater;

lPlace with strenuous vibration;

lOutside

■ Please use dry powder fire extinguisher in case of fire; it is forbidden to use fluid

fire extinguisher because it will cause electric shock.


■ Please put the socket near the UPS, in this way, it is convenient to disconnect the socket and cut off power in case of emergency.

ALARM! The UPS must be connected with a wire to the ground!

## 2. Working Principle


### 2.1 In AC mode

When UPS is in normal working mode, AC goes through the filter and the harmful waves are filtered. After that, AC charges the battery and meanwhile, passes UPS AVR and the filter and provide power for the equipment.

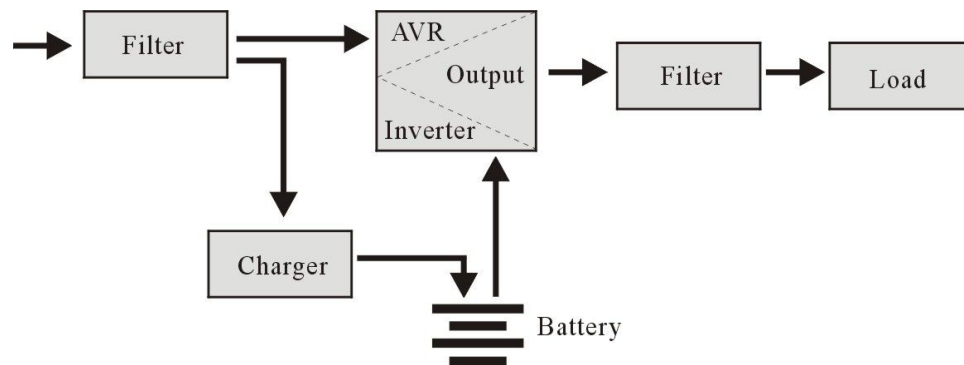

### 2.2 AC Failure

When AC fails, the battery will supply power to the inverter and then passes filter and provide power for the equipment, ensuring the continuous power supply.

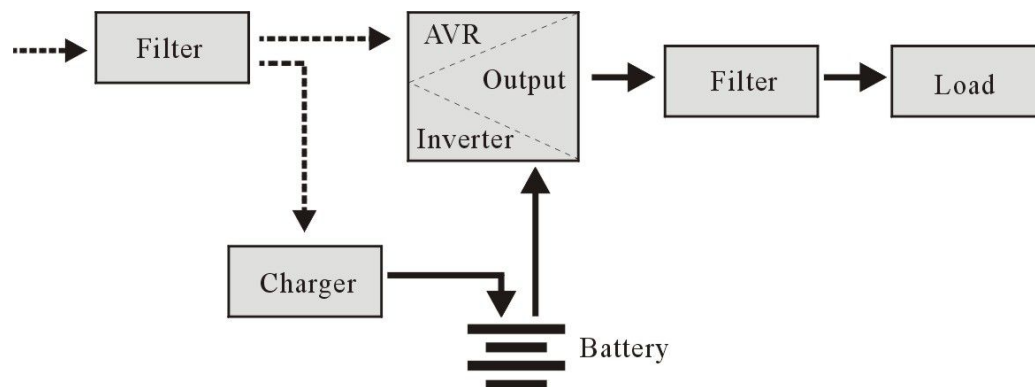

### 2.3 Battery and Charging:

1. When the UPS is connected to AC, the charger will charge the battery fully in about 10 hours.
2. When the battery is used up, please charge the battery immediately so that to prolong the life of the battery.

## 3. Main Features

### 3.1 Unattended Operation:

- Please connect the UPS to AC and press the ON button on the front panel, the UPS is turned on and the AC outputs stabilized voltage.
- When AC fails, UPS will supply power to the equipment immediately. And when the battery is used up, UPS will turn off automatically.
- When AC comes back, UPS will turn on automatically.

### 3.2 Protection:

- Battery over discharge protection: when the battery discharges and the UPS is in inverter mode, the battery will check and monitor the working status of the battery; when the battery voltage drops to the limited lowest voltage, the inverter will turn off automatically and protect the battery; When AC comes back, UPS will turn on automatically.
- Short-circuit Protection : when UPS is in inverter mode and there is shock or short-circuit, UPS will output limited currency, protecting the UPS( When in AC mode, the UPS will be protected first by input fuse and then transfers to the inverter working mode).

### 3.3 Interface Port (with function of intelligent monitoring of computer): (optional)

- This series UPS can have DB9 or USB interface port, which can service for such systems as MS-DOS, WINDOWS, NOVELL, UNIX, LAN, etc and keep files and monitor UPS to turn off automatically.
- Automatically check AC normal or bad and the battery voltage and send the alarm message to all the working systems.
- When AC fails, the UPS will turn off the systems and the UPS automatically.
- The interface provides the function of predicting and setting the time of uninterruptible power supply and record the UPS and AC status.
- Display the count-down time of turnoff of the UPS.
- Monitoring UPS remotely by TCP/IP.
- The interface can set the time of self-testing of the UPS and time delay of turnoff

### 3.4 Three Kinds of Alarm Function( new model)

- When AC fails, and the UPS supplies power, UPS will alarm once every 6 seconds and the beep stops about 40 seconds later.

■ When the battery is nearly used up, the UPS will alarm automatically and the beep frequency is once every 2 seconds.

■ When the battery is really used up, the UPS will alarm for a very long time and after 20 seconds, it will turn off automatically.

3.5 Lock Phase Function (new model): In AC mode, the UPS system automatically tracks AC phase and ensures that the output wave form of the inverter is the same with AC voltage wave form, in this way, it reduces the peak pulse and surge voltage and minimizes the interference and damage to the equipment.

3.6 The Function of the Self-set Frequency: When the UPS is turned on for the first time, the acquiescence frequency is 50/60Hz; when it is connected to AC, the frequency is automatically set to 50Hz or 60Hz in accordance with AC.


## 4. Specifications

MODEL	350VA	500VA /525VA	600VA /650VA	700VA /750VA	800VA /850VA	1000VA /1200VA	1500VA /1600VA
Battery	4AH×1	7AH×1	7AH×1	7AH×1	8AH×1	7AH×2 /12AH×1	8AH×2 /12AH×1
DC Voltage of long backup	12VDC	12VDC	12VDC	12VDC	12VDC	24VDC	24VDC
Type of load	Computer, displayer						
Input voltage	110V/120V/220V/230V/240V±25%						
Input freq.	50/60Hz±10%						
Output voltage	110V/120V/220V/230V/240V±10%						
Output freq.	50/60Hz±0.5Hz(in battery mode)						
Backup time	8~20mins(rated computer as load)						
Transfer time	≤10ms						
Short-circuit protection	Fuse in AC mode, limited output currency in inverter mode						
Efficiency of power	>80% in inverter mode						
Temperature	0℃~40℃						
Humidity	10%~90%						
Display	LED display: AC, charging, inverting/LCD(optional)						
Interface	RS232/USB(optional)						



Remark: Output and input voltage and frequency can be set according to customers' requirements.

## 5. Introduction


### 5.1 Off-line UPS LED

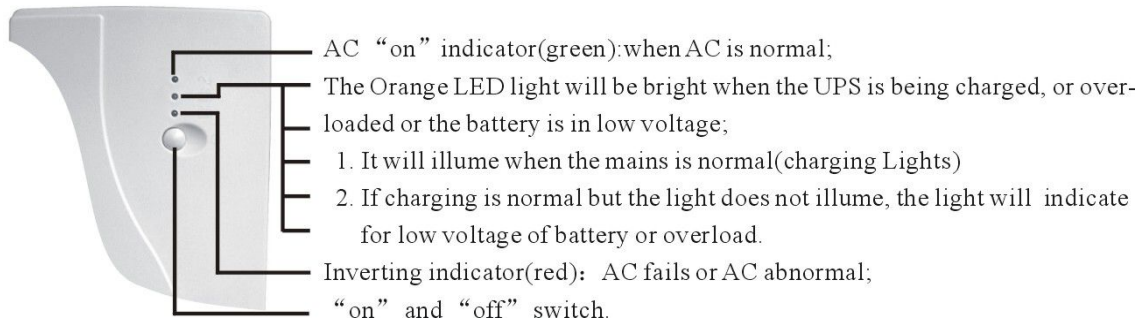

### 5.2 Off-line UPS LCD

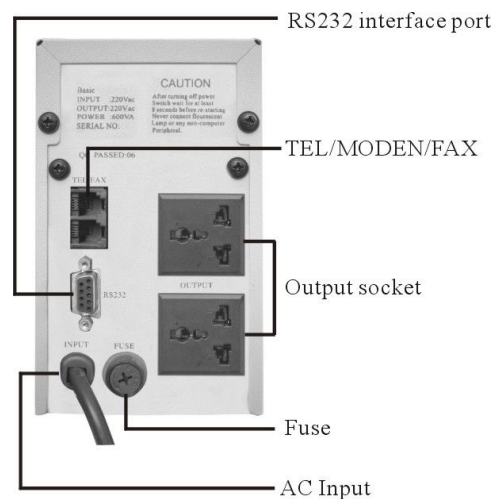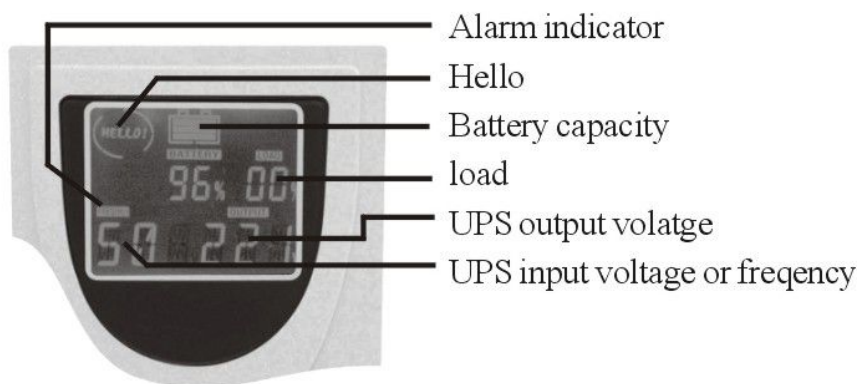

### 5.3 Outdoor UPS

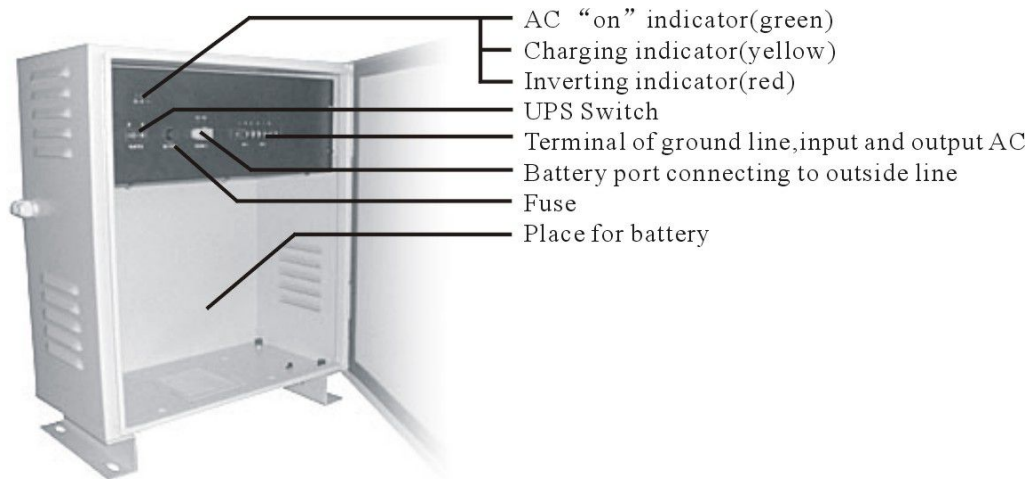

Name	Power	Battery inside	DC voltage
Cp150	120W	100AH×1	12VDC
CP150L	220W	100AH×1	12VDC
CP150LH	220W	100AH×2	24VDC
CP150LH-350W	350W	100AH×2	24VDC
CP150LH-400W	400W	100AH×2	24VDC


## 6. Installation and Operation

### 6.1 Installation for Standard UPS

- 1) Shut down the load (for example PC),pull out power gird.
- 2) Put UPS on the proper position(following the manual)
- 3) Connect load(for example PC) to the UPS
- 4) Put the plug to the AC power socket(make sure GND is connected well )

### SUGGESTION

OFFLINE UPS is the power supply for the computer monitor and hard disk(CD) etc. It has the limited back time for the load, so you'd better not connect the printer or other equipments to it.

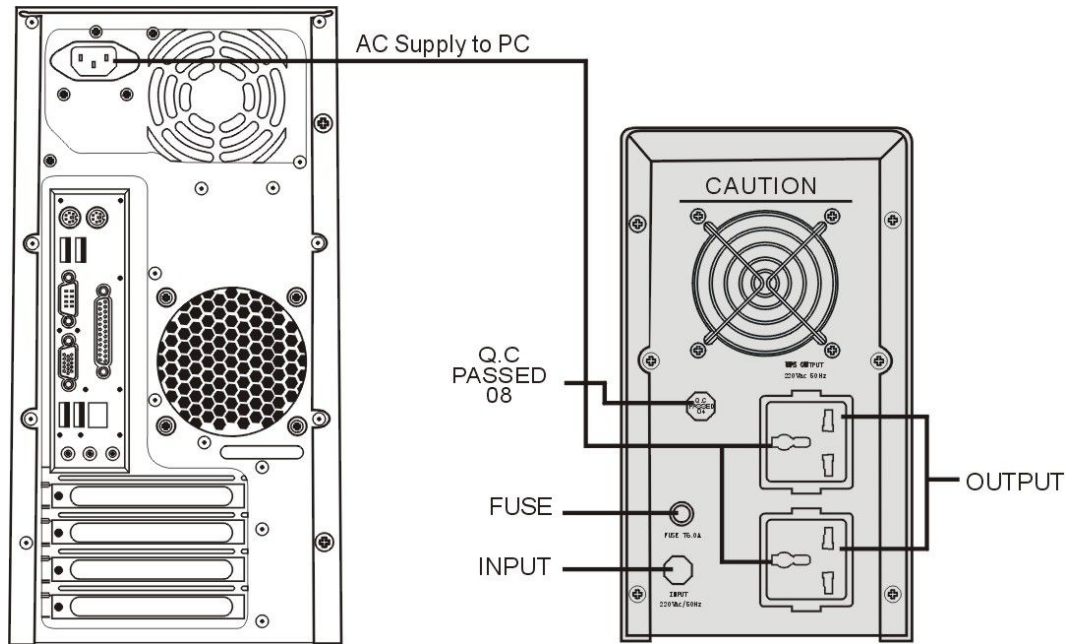

5) Connect to AC: press the panel switch turning on the UPS, the green LED and yellow LED light, then you can turn on your computer etc.

6) Battery mode: press the panel switch turning on the UPS, the red LED lights, then you can turn on your computer etc.

7) Normally turning UPS: press the panel switch turning on the UPS.

8) Normally turning off UPS: press the panel switch turning off the UPS.

Remark:

1) Generally speaking, don't turn off the UPS and keep battery charging.


2) Once AC fails, UPS will turn to battery mode, please save important documents in time.

## 6.2 Installation of Long Back-up UPS:


1) Installation batteries: connect the red cable to the anode and black cable to the cathode, (pay attention to 24VDC ups , for 2 batteries connecting in series)

2) when the connection is right, you'd better connect with UPS before testing the voltage 24VDC .



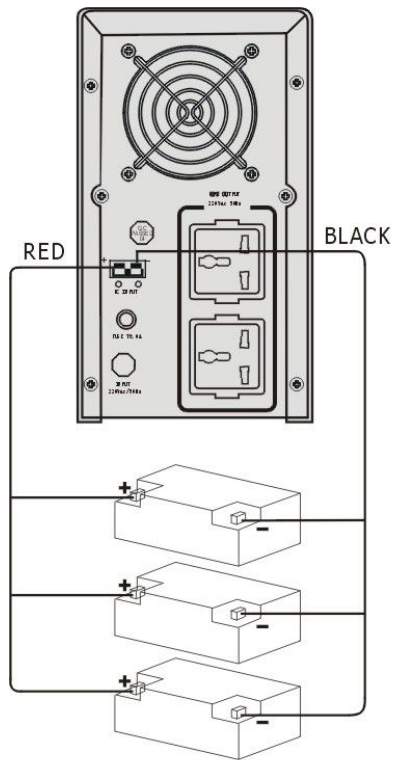

12VDC UPS

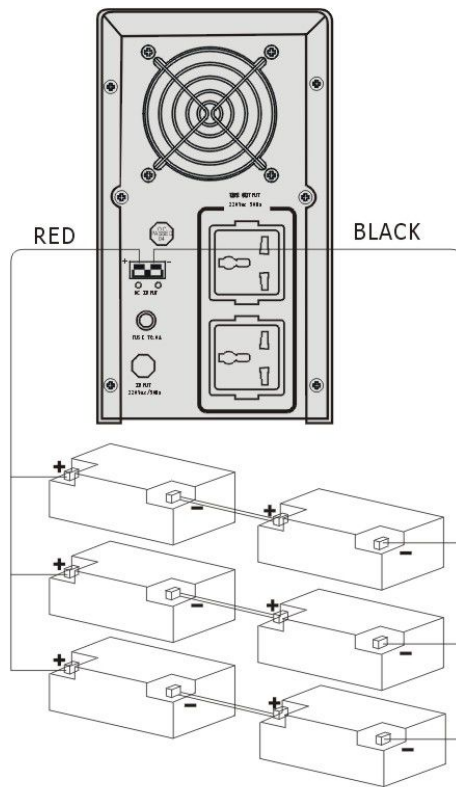

24VDC UPS

## 7. Maintenance

### 7.1 Preventative Maintenance

Preventive Maintenance ensures the longer Service life of UPS.

Please check the following steps every month:

1. Turn off the UPS;
2. Make sure the airway not blocked;
3. Make sure that the UPS surface is not covered by dust;
4. Check whether the input, output and battery connecting lines are firm or not and the insulation is effective or not;
5. Make sure that the UPS is not affected with damp;
6. Turn on the UPS;
7. Let the UPS work in battery mode for about 5 minutes and in this period, if there is no other alarm from the UPS, then the UPS is normal; if there is other alarm message, please contact the local dealer for help.

## 7.2 Battery Maintenance

The UPS contains sealed lead-acid maintenance-free battery. The bad environment, the high discharge frequency, the high temperature, etc will dramatically reduce the use life of battery. The use life of battery will also reduce even it is not used. It is suggested to discharge the battery once every 3 months when AC is normal. The following is the steps of how to check the battery: when the battery is near the end of its life, the battery will end in bad performance. So, please remember the following steps of checking and maintenance:

1) Connect the UPS to AC and turn on the UPS, charge the battery for at least 10 hours, noting the load status.

2) Keep the load at that status and record the total power capacity of the load and then remove the input plug of the UPS( simulate AC failure), and the battery of the UPS will discharge until turn off automatically and record the discharge time. Please keep the record of the discharge time for later check.

3)The battery service life is about 2 to 3 years in normal conditions. But in such condition as: high temperature or high discharge frequency, the battery service life will reduce to about 0.5 to 1 year.

4)With the operating time passed, the capability of battery will be weakened( the discharge time will decrease).When the discharge time is 80% of the initial discharge time, the performance of the battery will be weakened faster and accordingly, the checking frequency of the battery should change from once every half year to once every month.

## 7.3 Handling of abnormality

The UPS can serve and provide protection to users' equipment, but if there is something abnormal, please turn to local UPS dealer for help, avoiding unnecessary damage to the UPS.

When the UPS has the following problems, please follow the Steps below and if the problem still can not be solved, Please contact the local dealer.

Phenomenon	Trouble Shooting
Battery fails to supply power.	Check whether the battery isn't charged charge enough? Check whether the UPS is not turned on correctly?
UPS doesn't turn to AC(the input plug of the UPS has been plugged into the AC socket and AC is normal, and the“on” button has been	Check whether the fuse is broken? The fuse is placed on the UPS back panel. After disconnecting the AC plug, put out the fuse and check whether the fuse is

pressed, but the AC indicating light is not bright and the alarm beeps.	broken, if so, please replace it with a new fuse.
When AC fails, the computer doesn't work.	Please turn on the UPS and charge the battery for at least 10 hours, when AC is normal and then turn on the UPS.
AC output is normal, but the alarm beeps.	AC is over voltage or low voltage.

#### 8. Packing List:

- 1.UPS: one piece;
- 2.Users' manual: one copy;
- 3.Fuse tube: two pieces;
- 4.Battery connector(only for long backup model): one piece;
- 5.Others: according to customers' requirements.